



Greystone Biotech LLC

COC# 145857
Lab # 214051
Date Rec'd 9/17/2026
Report Issued 10/1/2026

Certificate of Analysis



Project
Compound Retatrutide
Label Claim 10 mg
Batch/Lot 7162026


<u>Analyte</u>	<u>Result</u>	<u>Units</u>	<u>LOQ</u>	<u>% of Label</u>	<u>Method</u>	<u>Date</u>	<u>CAS</u>
Peptides & Bioactives							
Chromatographic purity	99.1	%	1		HPLC-UV/MS	9/25/2026	
Retatrutide	9.09	mg	.1	90.9	HPLC-UV-MS	9/25/2026	2381089-83-2
Mass Spectral Match	ID Confirmed				HPLC-UV-MS	9/25/2026	

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.
 Data is not for regulatory compliance nor diagnostic use.
 Methods shown reference current Krause Analytical SOPs
 ND - Not detected LOQ - limit of quantification
 OCH - above calibrated range OCL - below calibrated range
 All values reported on a per vial basis unless otherwise noted
 Copyright © 2026 Krause Analytical LLC. All rights reserved.


Respectfully submitted,

Mark C. Krause
 Laboratory Director

CHROMATOGRAM

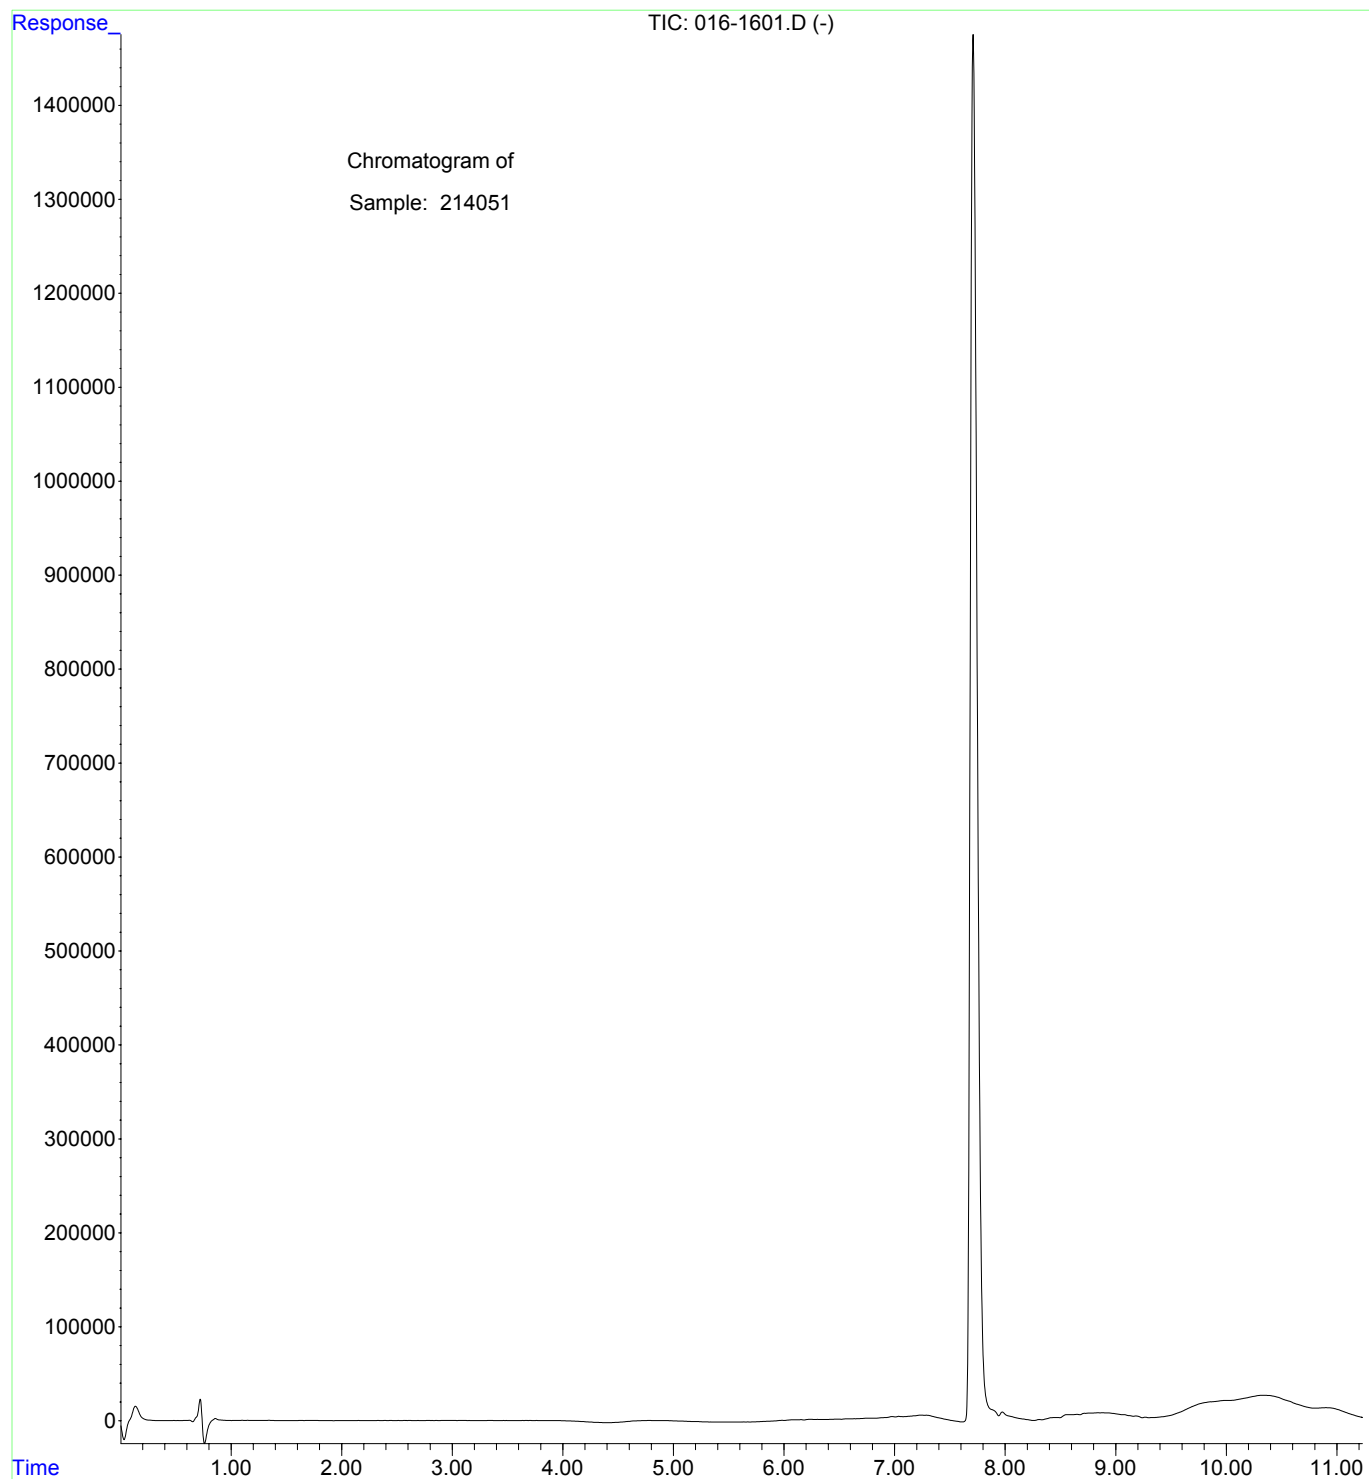

214051 421 (7.784) Cm (419:426)

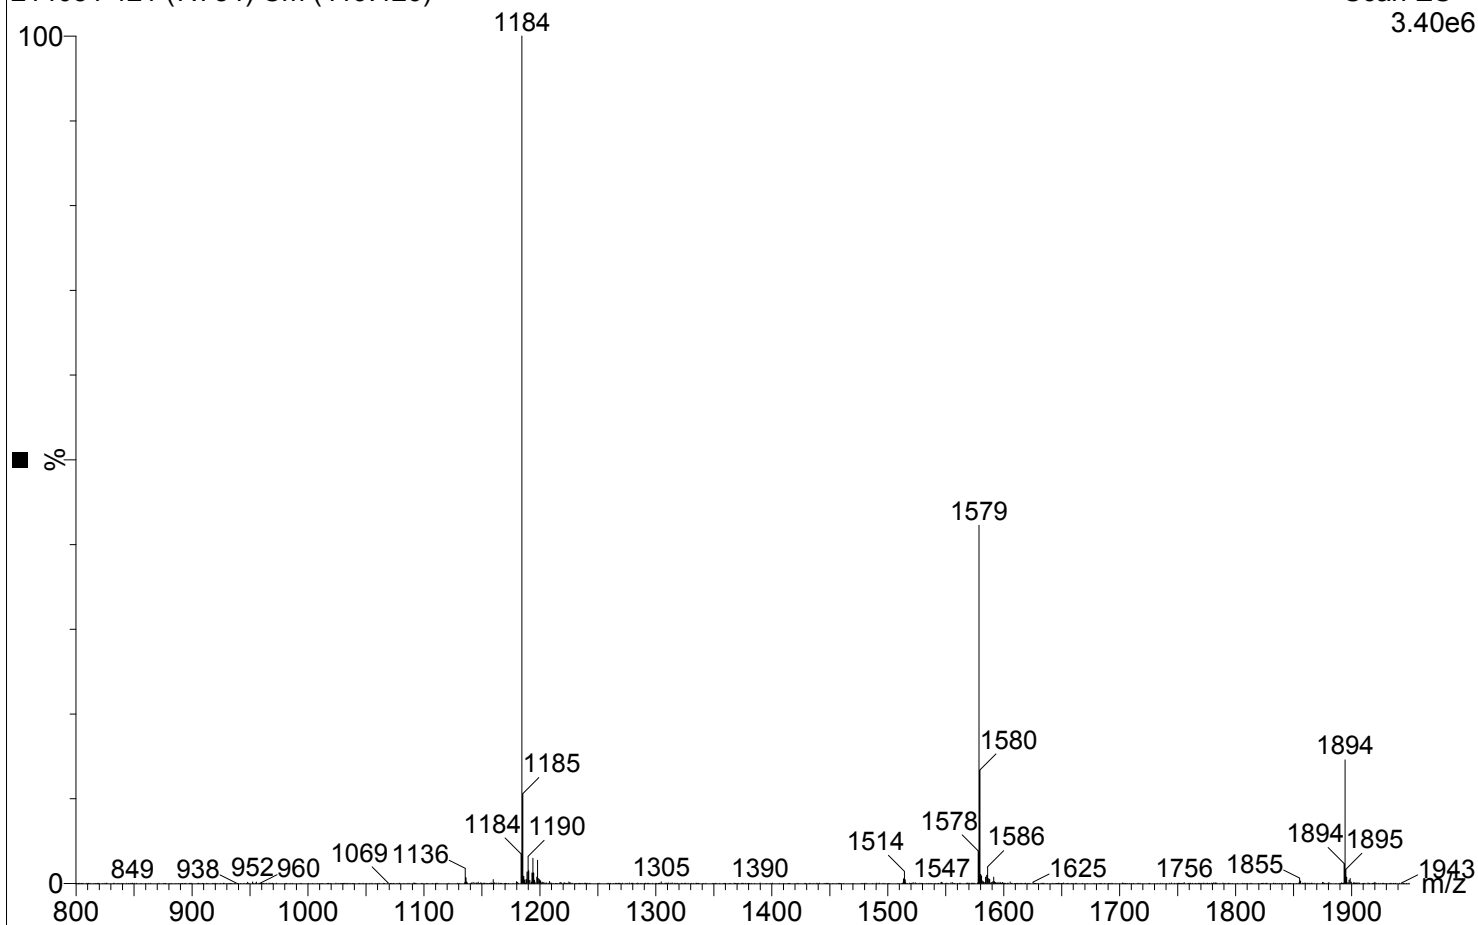Scan ES+
3.40e6

Retatrutide 423 (7.821) Cm (414:428)

Scan ES+
3.40e6